


REVISION No. 9

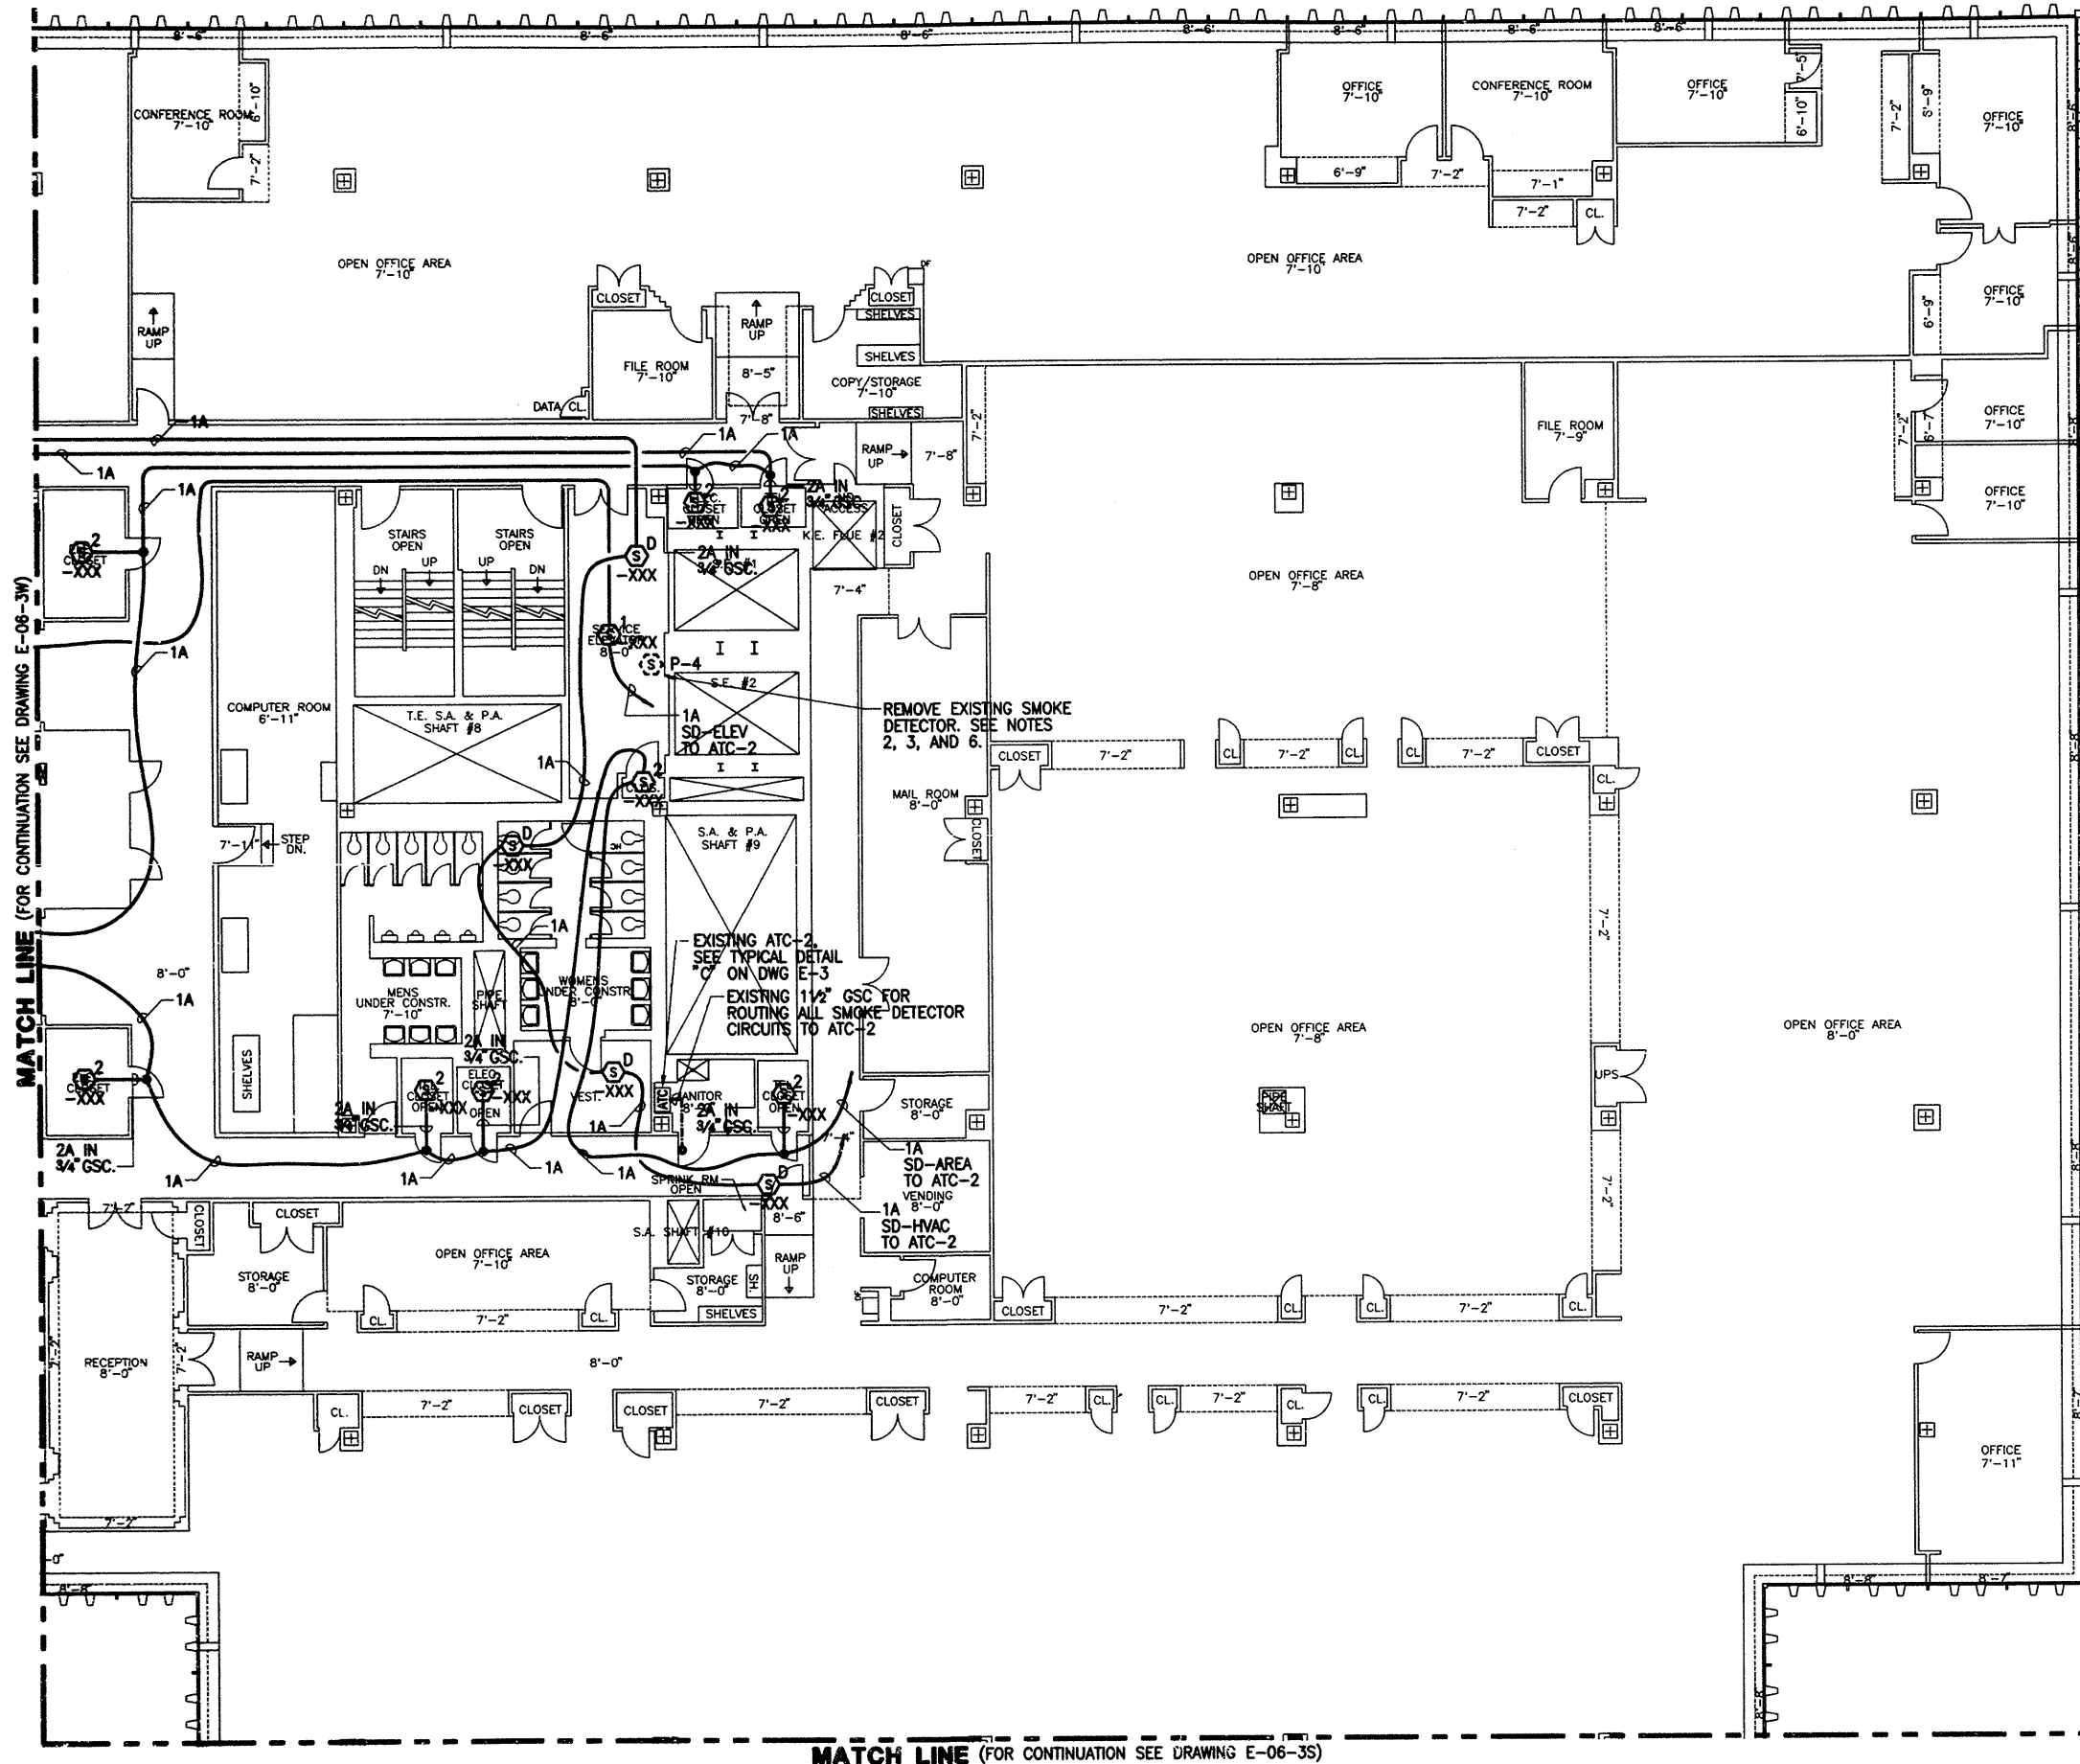

MATCH LINE (FOR CONTINUATION SEE DRAWING E-06-35)

**NOTES**

1. FOR LEGEND, ABBREVIATIONS, AND GENERAL NOTES, SEE DWG. E-1. FOR INSTALLATION DETAILS, SEE DWGS. E-2. FOR WIRING DIAGRAMS, SEE DWGS. E-3 AND DWG. E-4.
2. CONTRACTOR SHALL REMOVE EXISTING SMOKE DETECTORS ONLY AFTER INSTALLED DEVICES ARE OPERATIONAL.
3. FOR REMOVAL AND PATCHING PLAN DETAILS (P-1, P-2, P-3 & P-4), SEE DWG. A-1.
4. FOR RETURN AIR SMOKE DETECTORS ARRANGEMENT AND NOTES, SEE DWG. M-1.
5. NOT USED.
6. DISCONNECT AND ABANDON EXISTING SMOKE DETECTOR CIRCUITS IN CEILING. TAPE ENDS OF ABANDONED CONDUCTORS AND TAG AS ABANDONED. THIS WORK SHALL BE DONE IN THE PRESENCE OF THE ENGINEER.

Sheet 66 of 84

**THE PORT AUTHORITY**  
OF NEW YORK

*[Signature]*  
ENGINEERING PROGRAM MANAGER  
WORLD TRADE CENTER  
CHIEF ELECTRICAL ENGINEER

No.	Date	Revision	Approved																		
<b>ENGINEERING DEPARTMENT</b>																					
<b>WORLD TRADE CENTER</b>																					
<b>ELECTRICAL</b>																					
Title																					
FIRE ALARM SYSTEM DEVICE UPGRADE PHASE III 5 WTC 3rd, 4th, 5th & 6th FLOORS																					
6th FLOOR SMOKE DETECTOR INSTALLATION AND REMOVAL EAST PART PLAN																					
This drawing subject to conditions in Contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.																					
<table border="0"> <tr> <td>FELDMAN</td> <td>KOBZAN</td> <td>A.S.</td> </tr> <tr> <td>Designed by</td> <td>Drawn by</td> <td>Checked by</td> </tr> <tr> <td colspan="3">NOVEMBER 26, 1999</td> </tr> <tr> <td colspan="3">Date</td> </tr> <tr> <td>WTC-861.573</td> <td colspan="2">E-06-3E</td> </tr> <tr> <td>Contract Number</td> <td colspan="2">Drawing Number</td> </tr> </table>				FELDMAN	KOBZAN	A.S.	Designed by	Drawn by	Checked by	NOVEMBER 26, 1999			Date			WTC-861.573	E-06-3E		Contract Number	Drawing Number	
FELDMAN	KOBZAN	A.S.																			
Designed by	Drawn by	Checked by																			
NOVEMBER 26, 1999																					
Date																					
WTC-861.573	E-06-3E																				
Contract Number	Drawing Number																				

**ENGINEERING DEPARTMENT**

**WORLD  
TRADE  
CENTER**

**ELECTRICAL**

Title  
FIRE ALARM SYSTEM  
DEVICE UPGRADE  
PHASE III  
5 WTC 3rd, 4th, 5th & 6th FLOORS

6th FLOOR  
SMOKE DETECTOR  
INSTALLATION AND  
REMOVAL  
EAST PART PLAN

This drawing subject to conditions in Contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

FELDMAN KOBZAN A.S.  
Designed by Drawn by Checked by

NOVEMBER 26, 1999  
Date

WTC-861.573 E-06-3E  
Contract Number Drawing Number

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-861.573 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.  
DATE 2/1/00 *[Signature]*  
DATE 2/1/00 *[Signature]*  
CONTRACT ENGR./ARCH.  
ENGINEERING PROGRAM MGR

